


To: Residential/Commercial Electrical Generation Installers and SL&P Self-Generation Customers

**Re: Utility Disconnect on Self-Generation Solar Projects**

Saskatoon Light & Power no longer requires the Utility Disconnect Switch for Customer Self-Generation systems be located beside the Utility Meter. The Utility Disconnect Switch is to be outside, readily accessible and clearly labelled as the "Utility Disconnect" as per Canadian Electric Code (CEC) 84-022 and 84-024. As well, there must be a warning notice of an interconnected system and a permanent single line diagram of the interconnected system at the utility disconnect and utility meter as per CEC 84-030.

Should you have any questions whatsoever regarding the interface of a generation system to our electric Utility, please contact me at any time. My contact number and email address are 306.975.3045 and [Nathan.Ziegler@saskatoon.ca](mailto:Nathan.Ziegler@saskatoon.ca)

Sincerely,

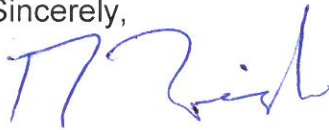

Nathan Ziegler  
Sustainable Electricity Engineer